

Job Name: _____

Purchaser: _____

Submitted To: _____

Construction: _____

Reference: _____

Approval: _____

Date: _____

Submitted By: _____

Unit: _____

Drawing #: _____

Model	Compatible Indoor Unit Model
UAMFB0912A	USYM09U
	USYM12U



Specifications


Model	Gauge	Finish	Dimensions			Required Filter (filter not included)
			Height	Width	Depth	
UAMFB0912A	24	Unfinished	9-11/16"	22"	25"	14" x 22" x 2"

See following page for filter box dimension diagram

Filter Box Pressure Drop (Mid Static Duct Filter Plenum + MERV13 Filter)

ESP Setting	Pressure Drop ("wg)		
	Low	Medium	High
0.1	0.05	0.06	0.07
0.15	0.06	0.07	0.08
0.2	0.07	0.08	0.09
0.28	0.08	0.09	0.11
0.36	0.09	0.10	0.12
0.4	0.10	0.11	0.14
0.44	0.11	0.12	0.15
0.48	0.12	0.14	0.15
0.52	0.13	0.14	0.17
0.6	0.14	0.16	0.17

Note: All measurements are shown in MM (IN). MM are rounded to the nearest MM, while IN are rounded to the nearest 1/8.

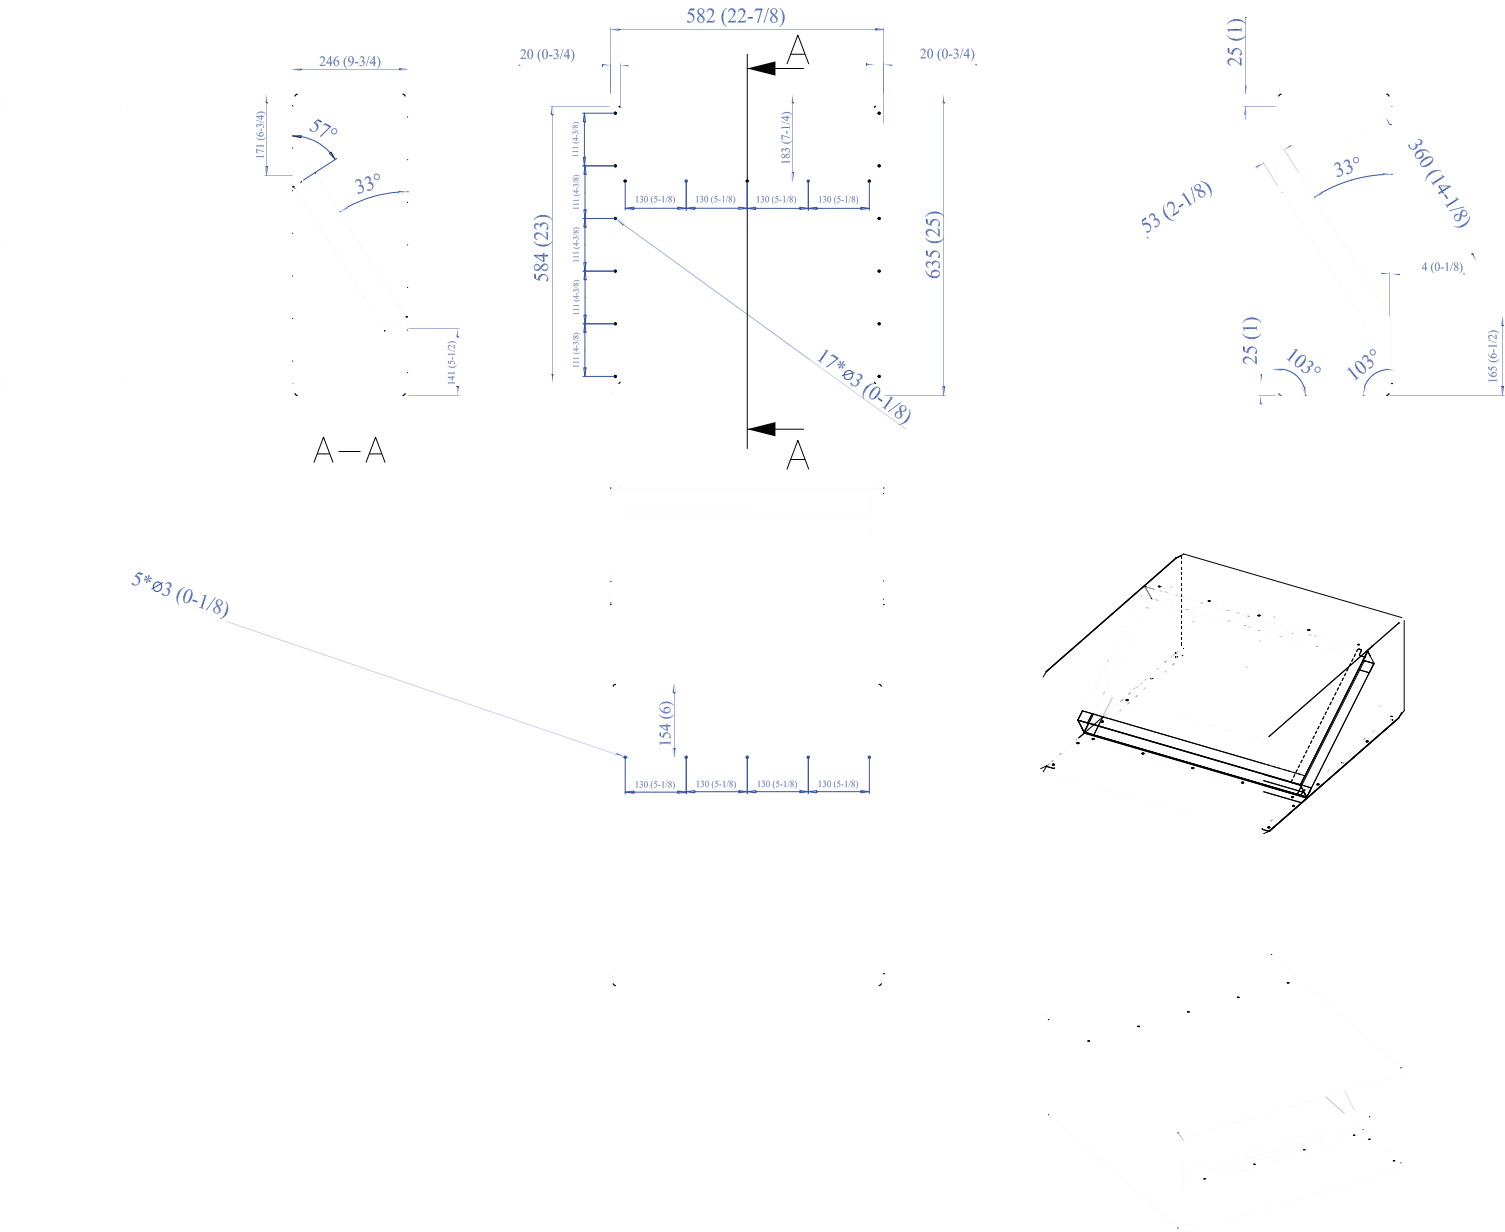

Job Name: _____

Purchaser: _____

Submitted To: _____

Construction: _____

Reference: _____

Approval: _____

Date: _____

Submitted By: _____

Unit: _____

Drawing #: _____

Model	Compatible Indoor Unit Model
UAMFB1824A	USYM18U
	USYM24U



Specifications

Model	Gauge	Finish	Dimensions			Required Filter (filter not included)
			Height	Width	Depth	
UAMFB1824A	24	Unfinished	9-5/8"	25-1/16"	38-3/4"	14" x 25" x 2"

See following page for filter box dimension diagram

Filter Box Pressure Drop (Mid Static Duct Filter Plenum + MERV13 Filter)

ESP Setting	Pressure Drop ("wg)		
	Low	Medium	High
0.1	0.05	0.06	0.07
0.15	0.06	0.07	0.08
0.2	0.07	0.08	0.09
0.28	0.08	0.09	0.11
0.36	0.09	0.10	0.12
0.4	0.10	0.11	0.14
0.44	0.11	0.12	0.15
0.48	0.12	0.14	0.15
0.52	0.13	0.14	0.17
0.6	0.14	0.16	0.17

